

Mono County Community Development Department

P.O. Box 347
Mammoth Lakes, CA 93546
(760) 924-1800, fax 924-1801

Building Division
www.monocounty.ca.gov

P.O. Box 8
Bridgeport, CA 93517
(760) 932-5432, fax 932-5431

Simplified Microinverter and ACM System for One-and Two-Family Dwellings 4.2

SCOPE: Use this plan ONLY for systems using utility-interactive Microinverters or AC Modules (ACM) not exceeding a combined system AC inverter output rating of 10 kW, with a maximum of 3 branch circuits, one PV module per inverter and with PV module ISC maximum of 10-A DC, installed on a roof of a one- or two-family dwelling or accessory structure. The photovoltaic system must interconnect to a single-phase AC service panel of 120/240 Vac with service panel bus bar rating of 225 A or less. This plan is not intended for bipolar systems, hybrid systems or systems that utilize storage batteries, charge controllers or trackers. Systems must be in compliance with current California Building Standards Codes and local amendments of the authority having jurisdiction (AHJ). Other articles of the California Electrical Code (CEC) shall apply as specified in section 690.3.

MANUFACTURER'S SPECIFICATION SHEETS MUST BE PROVIDED for proposed inverters, modules, combiner/junction boxes and racking systems. Installation instructions for bonding and grounding equipment shall be provided and local AHJs may require additional details. Listed and labeled equipment shall be installed and used in accordance with any instructions included in the listing or labeling (CEC 110.3). Equipment intended for use with PV system shall be identified and listed for the application CEC 690.4(D).

Applicant and Site Information

Job Address: _____ Permit #: _____

Contractor/Engineer Name: _____ License # and Class: _____

Signature: _____ Date: _____ Phone Number: _____

1. General Requirements and System Information

Microinverter

Number of PV modules installed: _____

Number of Microinverters installed: _____

AC Module (ACM)

Number of ACMs installed: _____

Note: Listed Alternating-Current Module (ACM) is defined in CEC 690.2 and installed per CEC 690.6

1.1 Number of Branch Circuits, 1, 2 or 3: _____

1.2 Actual number of Microinverters or ACMs per branch circuit: 1 _____ 2. _____ 3. _____

1.3 Total AC system power rating = (Total Number of Microinverters or ACMs) * (AC inverter power output)
= _____ Watts

1.4 Lowest expected ambient temperature for this plan in Table 1: For -1° to -5° C use 1.12 or for -6° to -10° C use 1.14 correction factors.

1.5 Average ambient high temperature for this plan: = +47° C

Note: For lower expected ambient or higher average ambient high temperatures, use Comprehensive Standard Plan.

2. Microinverter or ACM Information and Ratings

Microinverters with ungrounded DC inputs shall be installed in accordance with CEC 690.35.

Microinverter or ACM Manufacturer: _____

Model: _____

2.1 Rated (continuous) AC output power: _____ Watts

2.2 Nominal AC voltage rating: _____ Volts

2.3 Rated (continuous) AC output current: _____ Amps

If installing ACMs, skip [STEPS 2.4]

2.4 Maximum DC input voltage rating: _____ Volts (limited to 79 V, otherwise use the Comprehensive Standard Plan)

2.5 Maximum input short circuit current: _____ Amps

2.6 Maximum AC output overcurrent protection device (OCPD) _____ Amps

2.7 Maximum number of microinverters or ACMs per branch circuit: _____

3. PV Module Information

(If installing ACMs, skip to [STEP 4])

PV Module Manufacturer: _____

Model: _____

Module DC output power under standard test conditions (STC) = _____ Watts

3.1 Module V_{oc} at STC (from module nameplate): _____ Volts

3.2 Module I_{sc} at STC (from module nameplate): _____ Amps

3.3 Adjusted PV Module DC voltage at minimum temperature = [Table 1] _____ [cannot exceed Step 2.4]

| Table 1. Module V_{oc} at STC Based on Inverter Maximum DC Input Voltage Derived from CEC 690.7 | | | | | | | | | | | | | | | | |
|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Microinverter Max. DC Input [STEP 2.4] (Volts) | 34 | 37 | 40 | 43 | 46 | 49 | 52 | 55 | 58 | 61 | 64 | 67 | 70 | 73 | 76 | 79 |
| Max. Module VOC @ STC, 1.12 (-1° to -5° C) Correction Factor (Volts) | 30.4 | 33.0 | 35.7 | 38.4 | 41.1 | 43.8 | 46.4 | 49.1 | 51.8 | 54.5 | 57.1 | 59.8 | 62.5 | 65.2 | 67.9 | 70.5 |
| Max. Module VOC @ STC, 1.14 (-6° to -10° C) Correction Factor (Volts) | 29.8 | 32.5 | 35.1 | 37.7 | 40.4 | 43.0 | 45.6 | 48.2 | 50.9 | 53.5 | 56.1 | 58.8 | 61.4 | 64.0 | 66.7 | 69.3 |

4. Branch Circuit Output Information

Fill in [Table 3] to describe the branch circuit inverter output conductor and OCPD size. Use [Table 2] for determining the OCPD and Minimum Conductor size.

| Table 2. Branch Circuit OCPD and Minimum Conductor Size* | | | | |
|--|-----------------------|-------------|------------------------------|--|
| Circuit Current (Amps) | Circuit Power (Watts) | OCPD (Amps) | Minimum Conductor Size (AWG) | Minimum Metal Conduit Size for 6 Current Carrying Conductors |
| 12 | 2880 | 15 | 12 | ¾" |
| 16 | 3840 | 20 | 10 | ¾" |
| 20 | 4800 | 25 | 8 | 1" |
| 24 | 5760 | 30 | 8 | 1" |

*CEC 690.8 and 210.19 (A)(1) factored in Table 2, conductors are copper, insulation must be 90° C wet-rated. Table 2 values are based on maximum ambient temperature of 69° C, which includes 22° C adder, exposed to direct sunlight, mounted > 0.5 inches above rooftop, ≤ 6 current carrying conductors (3 circuits) in a circular raceway. Otherwise use Comprehensive Standard Plan.

| Table 3. PV Array Configuration Summary | | | |
|--|----------|----------|----------|
| | Branch 1 | Branch 2 | Branch 3 |
| Number of Microinverters or ACMs [Step 1] | | | |
| Selected Conductor Size [Table 2] (AWG) | | | |
| Selected Branch and Inverter Output OCPD [Table 2] | | | |

5. Solar Load Center (if used)

5.1 Circuit Power see [Step 1.3] = _____ Watts

5.2 Circuit Current = (Circuit Power)/(AC voltage)= _____ Amps

5.3 Solar Load Center Bus Bar Rating (use Table 4) = _____ Min. Amps

5.4 Solar Load Center Feeder Breaker Rating (use Table 4) = _____ Amps

NOTE: If OCPDs of circuits other than for the inverter outputs are present, solar load center bus bar rating must be a minimum of 100 Amps, and the feeder breaker is limited to a maximum of 60 Amps

| Table 4. Solar Load Center and Total Inverter Output OCPD and Conductor Size** | | | | |
|--|-----------------------|-------------|------------------------------|----------------------------|
| Circuit Current (Amps) | Circuit Power (Watts) | OCPD (Amps) | Minimum Conductor Size (AWG) | Minimum Metal Conduit Size |
| 24 | 5760 | 30 | 10 | ½" |
| 28 | 6720 | 35 | 8 | ¾" |
| 32 | 7680 | 40 | 8 | ¾" |
| 36 | 8640 | 45 | 8 | ¾" |
| 40 | 9600 | 50 | 8 | ¾" |
| 41.6 | ≤ 10000 | 60 | 6 | ¾" |

**CEC 690.8 and 210.19 (A)(1) factored in Table 4, conductors are copper, insulation must be 90° C wet-rated. Table 4 values are based on maximum ambient temperature of 47° C (no rooftop temperature adder in this calculation), ≤ 3 current carrying conductors in a circular raceway. Otherwise use Comprehensive Standard Plan.

***Exception: listed combiners are permitted to be used when they're installed in accordance with their listing and the manufacturer's instructions.

6. Point of Connection to Utility:

6.1 Inverter(s) must be connected to either load or supply side of service disconnecting means.

Either Step 6.2 or 6.3 below should be filled out, and either Single Line Diagram #1- or Single-Line Diagram #2 should be filled out.

6.2 Is the PV OCPD positioned at the opposite end from input feeder location or main OCPD location?

Yes No (If No, then use 100% row in Table 5)

(Combined inverter output OCPD size + Main OCPD size) ≤ [bus bar size × (100% or 120%)]

| Table 5. Maximum Combined Inverter Output Circuit OCPD | | | | | | | | | | |
|---|-----|-----|-----|-----------------|-----------------|-----|-----------------|-----------------|-----|--|
| Bus Bar Size (Amps) | 100 | 125 | 125 | 200 | 200 | 200 | 225 | 225 | 225 | |
| Main OCPD (Amps) | 100 | 100 | 125 | 150 | 175 | 200 | 175 | 200 | 225 | |
| Maximum Combined Inverter OCPD with 120% of bus bar rating (Amps) | 20 | 50 | 25 | 60 [†] | 60 [†] | 40 | 60 [†] | 60 [†] | 45 | |
| Maximum Combined Inverter OCPD with 100% of bus bar rating (Amps) | 0 | 25 | 0 | 50 | 25 | 0 | 50 | 25 | 0 | |

[†]This plan limits the maximum system size to less than 10 kW, therefore the OCPD size is limited to 60 A. Reduction of Main Breaker is not permitted with this plan.

6.3 Supply side connections only (Per 705.12(A)):

Only use this section for connections on the supply side of the service disconnecting means. Select one:

- Utility- and AHJ-approved meter socket adapter.

Adapter name/model: _____

- Service equipment listed for the purpose of PV interconnection.

Description / model number(s): _____

7. Grounding and Bonding


Check one of the boxes for whether system is grounded or ungrounded: Grounded Ungrounded

For Microinverters with a grounded DC input, systems must follow the requirements of GEC (CEC 690.47) and EGC (CEC 690.43).

For ACM systems and Microinverters with ungrounded a DC input follow the EGC requirements of (CEC 690.43).

8. Markings

Informational note: ANSI Z535.4 provides guidelines for the design of safety signs and labels for application to products. A phenolic plaque with contrasting colors between the text and background would meet the intent of the code for permanency. No type size is specified, but 20 point (3/8") should be considered the minimum.

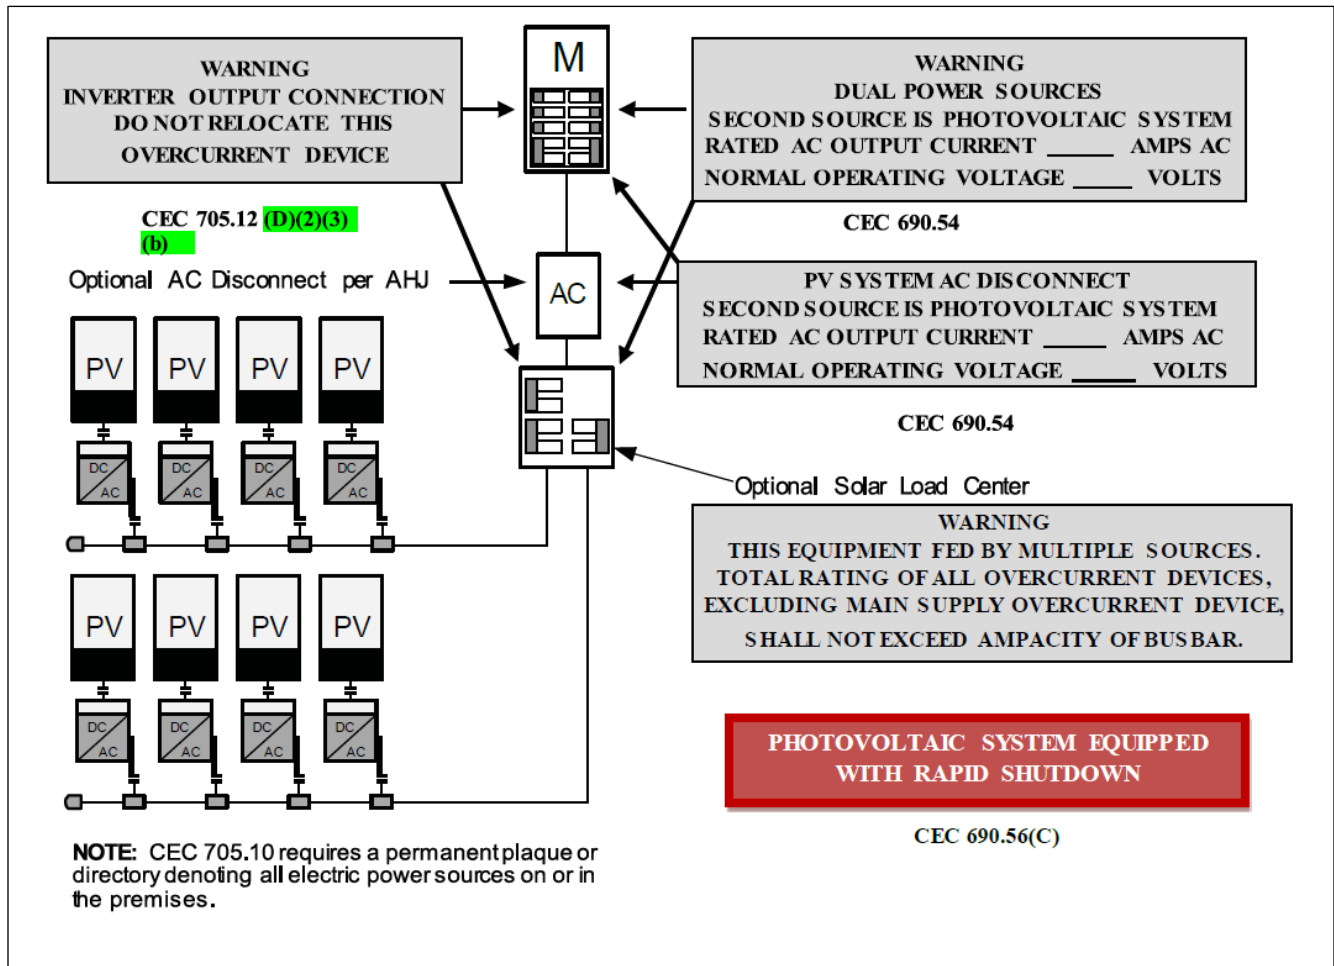


Equipment Schedule

| △ TAG | DESCRIPTION: (Provide model # if provided) |
|-------|---|
| 1 | Solar PV Module or ACM: |
| 2 | Microinverter (if not ACM): |
| 3 | Junction Box: |
| 4 | Solar Load Center, Yes / No: |
| 5 | Performance Meter Yes / No: |
| 6 | *Utility External Disconnect Switch Yes / No: |
| 7 | Main Electrical Service Panel |

Single-Line Diagram #1 for Microinverters or ACMs (Load Side Connection)

Check a box for dc system grounding: Grounded, Ungrounded
 For ungrounded dc power systems, EGC is required
 For grounded dc power systems, GEC & EGC are required
 Refer to CEC 250.120 for EGC installation & Table 250.122 for sizing


* Consult with your local AHJ and /or Utility

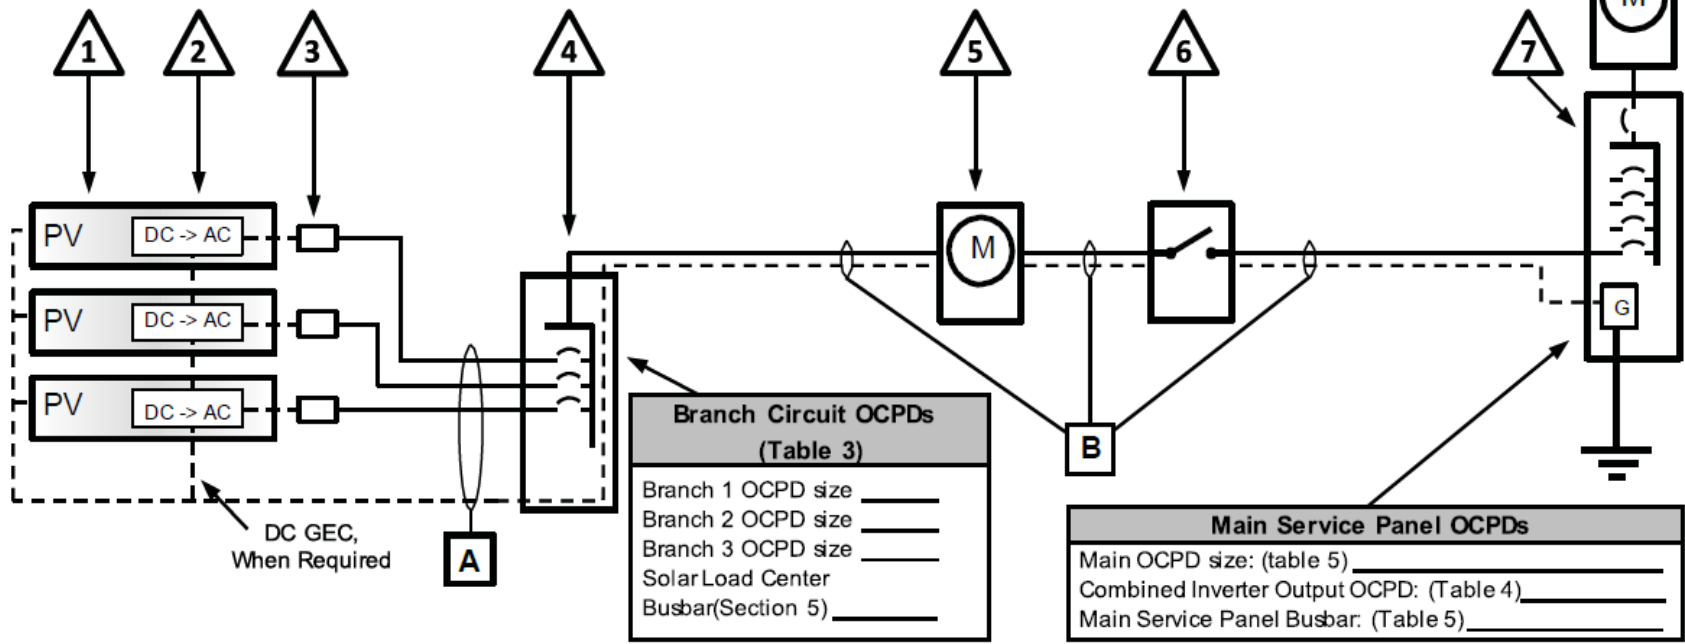

Conductor, Cable and Conduit Schedule

| TAG | Description and Conductor Type: (Table 3) | Conductor Size | Number of Conductors | Conduit/ Conductor/ Cable Type | Conduit Size |
|-----|--|----------------|----------------------|--------------------------------|--------------|
| A | Current-Carrying Conductors: (for each branch circuit) | | | | |
| | EGC: | | | | |
| | GEC (when required): | | | | |
| B | Current-Carrying Conductors: | | | | |
| | EGC: | | | | |
| | GEC (when required): | | | | |

SOLAR PV STANDARD PLAN - SIMPLIFIED
Microinverter and ACM Systems for One- and Two-Family Dwellings
ROOF LAYOUT PLAN



4.2

Items required: roof layout of all panels, modules, clear access pathways and approximate locations of electrical disconnecting means and roof access points.